

EMC TECHNICAL CONSTRUCTION FILE

FOR

ZHEJIANG GEYA ELECTRICAL CO., LTD

Wenzhou Bridge Industrial Zone, Beibaixiang Town, Yueqing, Zhejiang, China

Name Of Sample..	Residual Current Circuit Breaker with Overcurrent Protection
Model.....	GYR10NE
Main Model.....	GYR10NE
Ratings.....	Un:110/230/240V; In: 6A,10A,GYR10NE ,20A,25A,32A,40A; Ui:500V Uimp:4kV; IΔn:0.03A,0.1A,0.3A; Poles: 1P+N; Working frequency: 50/60Hz; Inc:4500A,6000A; IΔc:4500A,6000A; Im:500A; IΔm:500A;
Trade Name.....	/
Date of Receipt...	August 26,2025
Date of Test.....	August 26,2025 to September 02,2025
Engineer.....	Sophia Yu
Reviewed By.....	Linda lin
Approved By.....	Cristine Fang
<p>* The above equipment was tested by Shanghai Global Testing Services Co., Ltd. for compliance with the requirements set forth in the EMC Directive 2014/30/EU and the technical standards mentioned above. The results of testing in this report apply only to the product/system, which was tested. Other similar equipment will not necessarily produce the same results due to production tolerance and measurement uncertainties.</p>	



Test Result	PASS
--------------------	-------------

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

TABLE OF CONTENTS

GENERAL INFORMATION	4
PRODUCT DESCRIPTION FOR EQUIPMENT UNDER TEST (EUT)	4
OBJECTIVE	4
EQUIPMENT MODIFICATIONS	4
1 – IEC/EN 61543(CISPR 14)	5
1.1 CONTINUOUS DISTURBANCE VOLTAGE AT MAINS TERMINAL	5
1.1.1 TEST EQUIPMENT LIST AND DETAILS	5
1.1.2 DESCRIPTION OF MEASUREMENT CONDITIONS	5
1.1.3 LIMITS OF CONTINUOUS DISTURBANCE VOLTAGE AT MAINS TERMINAL	5
1.1.4 TEST PROCEDURE AND THE TEST SET-UP	6
SET-UP	6
1.1.5 TEST DATA AND RECORDS	6
1.1.6 VERDICT	7
1.2 RADIATION DISTURBANCES	8
1.2.1 TEST EQUIPMENT LIST AND DETAILS	8
1.2.2 DESCRIPTION OF MEASUREMENT CONDITIONS	8
1.2.3 LIMITS OF RADIATED DISTURBANCES OF CLASS B ITE AT A MEASURING DISTANCE OF 3M.	8
1.2.4 TEST PROCEDURE AND THE TEST SET-UP	8
1.2.5 TEST DATA AND RECORDS	9
1.2.6 VERDICT THE EUT MET THE REQUIREMENT.	10
1.3 DISTURBANCE POWER	11
3.3.1 TEST EQUIPMENT LIST AND DETAILS	11
1.3.2 DESCRIPTION OF MEASUREMENT CONDITIONS	11
1.3.3 LIMITS OF DISTURBANCE POWER	11
1.3.4 CONFIGURATION	11
1.3.5 TEST DATA AND RECORDS	11
1.3.6 VERDICT	11
1.4 DISCONTINUOUS DISTURBANCE VOLTAGE AT MAINS TERMINAL (CLICK)	12
1.4.1 TEST EQUIPMENT LIST AND DETAILS	12
1.4.2 DESCRIPTION OF MEASUREMENT CONDITIONS	12
1.4.3 LIMITS OF CLICK	12
1.4.4 CONFIGURATION	12
1.4.5 TEST DATA AND RECORDS	12
1.4.6 VERDICT	12
2 –IEC/EN 61543	13
DESCRIPTION OF PERFORMANCE CRITERION	13
PERFORMANCE CRITERION A	13
PERFORMANCE CRITERION B	13
PERFORMANCE CRITERION C	13
2.1 SURGES	14
2.1.1 TEST EQUIPMENT LIST AND DETAILS	14
2.1.2 DESCRIPTION OF MEASUREMENT CONDITIONS	14
2.1.3 CONFIGURATION	14

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

2.1.4 TEST DATA AND RECORDS	14
2.1.5 VERDICT	14
2.2 ESD	15
2.2.1 TEST EQUIPMENT LIST AND DETAILS	15
2.2.2 DESCRIPTION OF MEASUREMENT CONDITIONS	15
2.2.3 CONFIGURATION	15
2.2.4 TEST DATA AND RECORDS	15
2.2.5 VERDICT	16
2.3 EFT/B	17
2.3.1 TEST EQUIPMENT LIST AND DETAILS	17
2.3.2 DESCRIPTION OF MEASUREMENT CONDITIONS	17
2.3.3 CONFIGURATION	17
2.3.4 TEST DATA AND RECORDS	17
2.3.5 VERDICT	17
2.4 INJECTED CURRENTS	18
2.4.1 TEST EQUIPMENT LIST AND DETAILS	18
2.4.2 DESCRIPTION OF MEASUREMENT CONDITIONS	18
2.4.3 CONFIGURATION	18
2.4.4 TEST DATA AND RECORDS	18
2.4.5 VERDICT	18
2.5 VOLTAGE DIPS AND INTERRUPTIONS	19
2.5.1 TEST EQUIPMENT LIST AND DETAILS	19
2.5.2 DESCRIPTION OF MEASUREMENT CONDITIONS	19
2.5.3 CONFIGURATION	19
2.5.4 TEST DATA AND RECORDS	19
2.5.5 VERDICT	19
2.6 RADIO-FREQUENCY ELECTROMAGNETIC FIELD	20
2.6.1 TEST EQUIPMENT LIST AND DETAILS	20
2.6.2 DESCRIPTION OF MEASUREMENT CONDITIONS	20
2.6.3 CONFIGURATION	20
2.6.4 TEST DATA AND RECORDS	20
2.6.5 VERDICT	20
2.7 POWER-FREQUENCY MAGNETIC FIELD	21
2.7.1 TEST EQUIPMENT LIST AND DETAILS	21
2.7.2 DESCRIPTION OF MEASUREMENT CONDITIONS	21
2.7.3 CONFIGURATION	21
2.7.3 TEST DATA AND RECORDS	21
2.7.4 VERDICT	21
2.8 CURRENT OSCILLATORY TRANSIENTS(RING WAVE)	22
2.8.1 TEST DATA AND RECORDS	22
2.8.2 VERDICT	22
2.9 CONDUCTED COMMON MODE DISTURBANCES IN THE FREQUENCY RANGE LOWER THAN 150 KHZ	23
2.9.1 TEST DATA AND RECORDS	23
2.9.2 VERDICT	23

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

GENERAL INFORMATION

Product Description for Equipment under Test (EUT)

The product that is produced by **ZHEJIANG GEYA ELECTRICAL CO., LTD.** Test model: **GYR10NE** the "EUT" as referred to in this report is a **Residual Current Circuit Breaker with Overcurrent Protection**, Application model: **GYR10NE**

Complete test was conducted on **GYR10NE** ;

A representative sample of the product covered by this report has been tested and complies with the applicable requirements of this standard.

Objective

In order to meet the EMC requirements approved by CENELEC, the following standards will be cited:

1. EN IEC 61543:2023+A11:2023 , Residual current-operated protective devices (RCDs) for household and similar use Electromagnetic compatibility.

Note: The test data is only valid for the test sample. There is possible deviation from the original test data for other products

Equipment Modifications

No modification to the EUT was made by **Shanghai Global Testing Services Co., Ltd** to make sure the EUT comply with applicable limits.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

1 – EN 61543(CISPR 14)

1.1 Continuous Disturbance Voltage at Mains Terminal.

1.1.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Serial No.	Cal. Date	Cal. Due date
1	EMI test receiver	Rohde & Schwarz	ESCS25	1005426	2025-06-03	2026-06-02
2	Line impedance stabilization network	SCHWARZBECK	NSLK838	8127-350	2025-06-03	2026-06-02

1.1.2 Description of Measurement Conditions

Temperature: 21 °C
 Humidity: 58%
 Pressure: 1033mbar
 Electromagnetic environment: normal

1.1.3 Limits of Continuous Disturbance Voltage at Mains Terminal.

Equipment type	Frequency range MHz	Limit values dB μ V	
		Quasi-peak	Average
Household appliance	0.15 to 0.5	66-56 ^a	56- 46 ^a
	0.5 to 5	56	46
	5 to 30	60	50

^a Decreasing linearly with logarithm of the frequency.

Note: If the limit for the measurement with the average detector is met when using a receiver with a quasi-peak detector, the equipment under test shall be deemed to meet both limits and the measurement using the receiver with an average detector need not be carried out.


1.1.4 Test procedure and the test set-up

Procedure



- a. The EUT was placed 0.4 meters from the conducting wall of the shielded room with EUT being connected to the power mains through a line impedance stabilization network (LISN). Other support units were connected to the power mains through another LISN. The two LISNs provide 50 Ohm/ 50uH of coupling impedance for the measuring instrument.
- b. Both lines of the power mains connected to the EUT were checked for maximum conducted interference.
- c. The frequency range from 150 kHz to 30 MHz was searched. Emission levels under limit -20dB of the prescribed limits could not be reported.

Set-up

The configuration is in accordance with the requirement in EN 61000-6-3, the sketch map as follow:

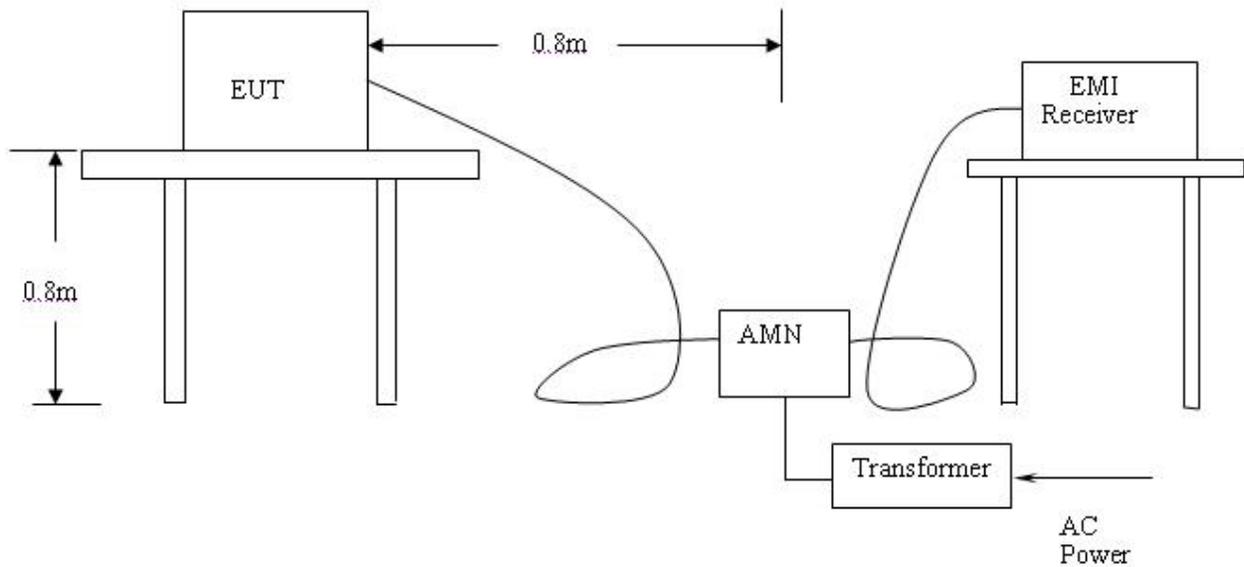

1.1.5 Test Data and Records

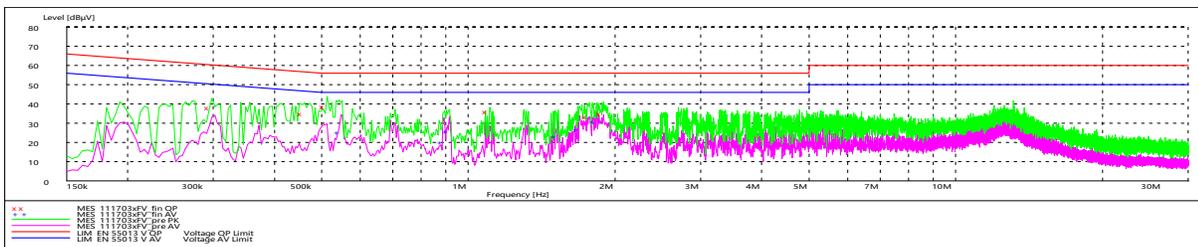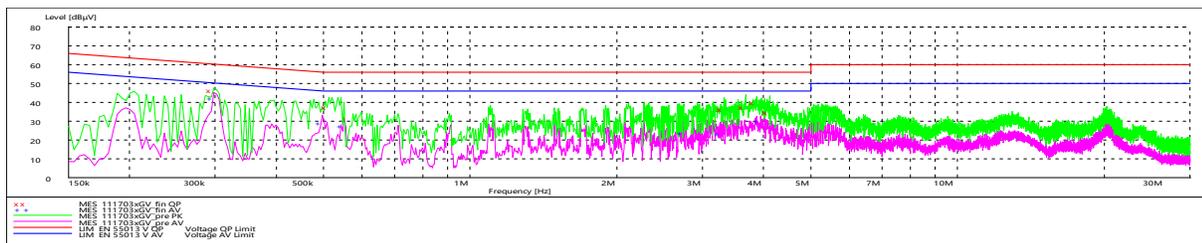

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

1.1.6 Verdict

The EUT met the requirement.

1.2 Radiation Disturbances

1.2.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Serial No.	Cal. Date	Cal. Due date
1	EMI test receiver	Rohde & Schwarz	ESU40	100987	2024-12-03	2025-12-02
2	Antenna	SCHWARZBECK	VULB9168	9168-493	2024-12-03	2025-12-02
3	CONTROLLER	INNCO	CO200	722	/	/

1.2.2 Description of Measurement Conditions

Temperature: 23 °C

Humidity: 60%

Pressure: 1033mbar

Electromagnetic environment: normal

1.2.3 Limits of radiated disturbances of class B ITE at a measuring distance of 3m.

Frequency range MHz	Quasi-peak limits(3m) dB(µV/m)
30 to 230	40
230 to 1000	47

NOTE: The lower limit shall apply at the transition frequency.
NOTE: Additional provisions may be required for cases where interference occurs.

1.2.4 Test procedure and the test set-up


Procedure

- a. The EUT was placed on the top of a rotating table 0.8 meters above the ground at a 3m semi/full-anechoic chamber. The table was rotated 360 degrees to determine the position of the highest radiation.
- b. The EUT was set 3 meters away from the interference-receiving antenna, which was mounted on the top of a variable-height antenna tower.
- c. The antenna is a broadband antenna, and its height is varied from one meter to four meters above the ground to determine the maximum value of the field strength. Both horizontal and vertical polarization of the antenna are set to make the measurement.
- d. For each suspected emission, the EUT was arranged to its worst case and then the antenna was tuned to heights from 1 meter to 4 meters and the turn table was turned from 0 degrees to 360 degrees to find the maximum reading.
- e. The test-receiver system was set to Peak Detect Function and Specified Bandwidth with Maximum Hold Mode.
- f. If the emission level of the EUT in peak mode was 10 dB lower than the limit specified, then testing could be stopped and the peak values of the EUT would be reported. Otherwise the emissions that did not have 10 dB margin would be retested one by one using the quasi- peak method or average method as specified and then reported In Data sheet peak mode and QP mode.



Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

Set-up

The configuration is in accordance with the requirement in EN 55032, the sketch map as follow:

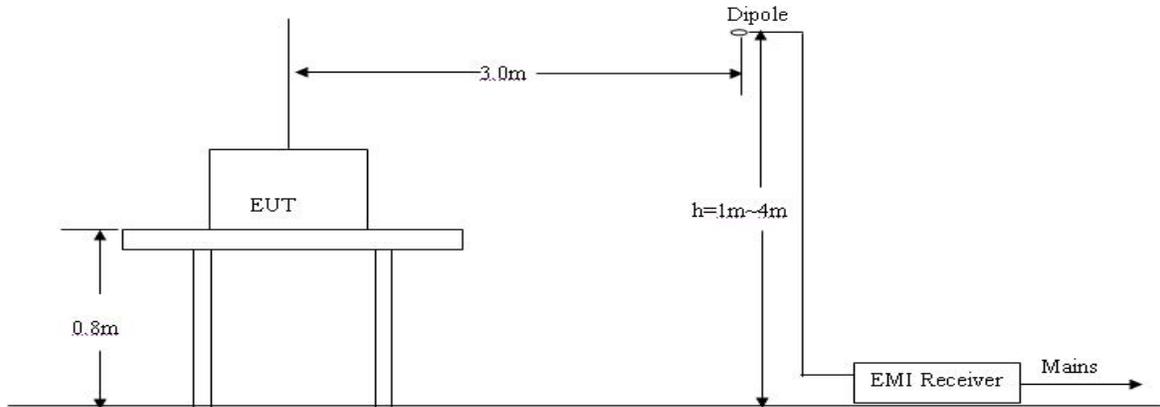

1.2.5 Test Data and Records

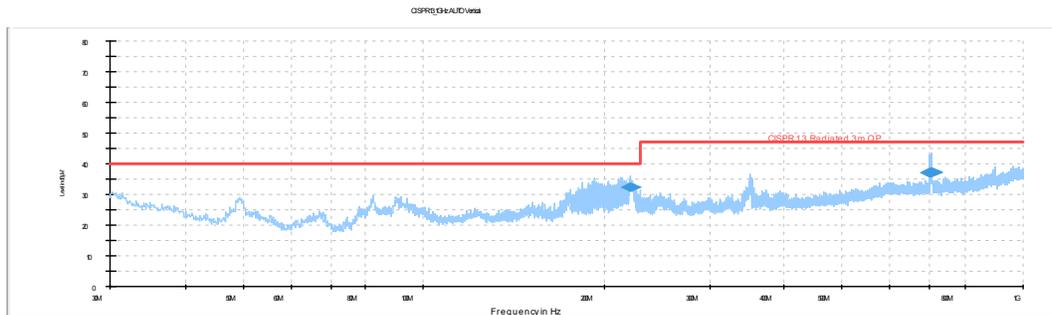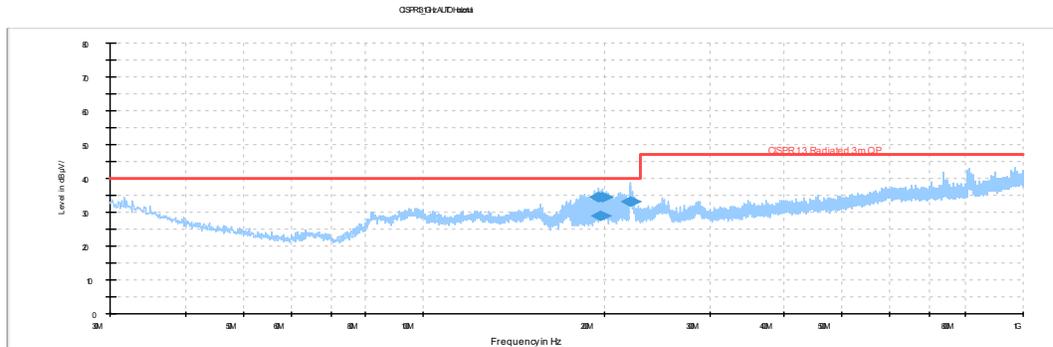

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

1.2.6 Verdict

The EUT met the requirement.

1.3 Disturbance Power

3.3.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Serial No.	Cal. Date	Cal. Due date
1	EMI test receiver	Rohde & Schwarz	ESU40	100987	2024-12-03	2025-12-02

1.3.2 Description of Measurement Conditions


Temperature: 21 °C
 Humidity: 56%
 Pressure: 1033mbar
 Electromagnetic environment: normal

1.3.3 Limits of Disturbance Power

Equipment type	Frequency range MHz	Limit values (dBpW)	
		Quasi-peak	Average
Tools	30 to 300	55 to 65 ^a	45 to 55 ^a
^a Increasing linearly with frequency.			

1.3.4 Configuration

The configuration in accordance with the requirement in EN 55014-1, the sketch map as follow:

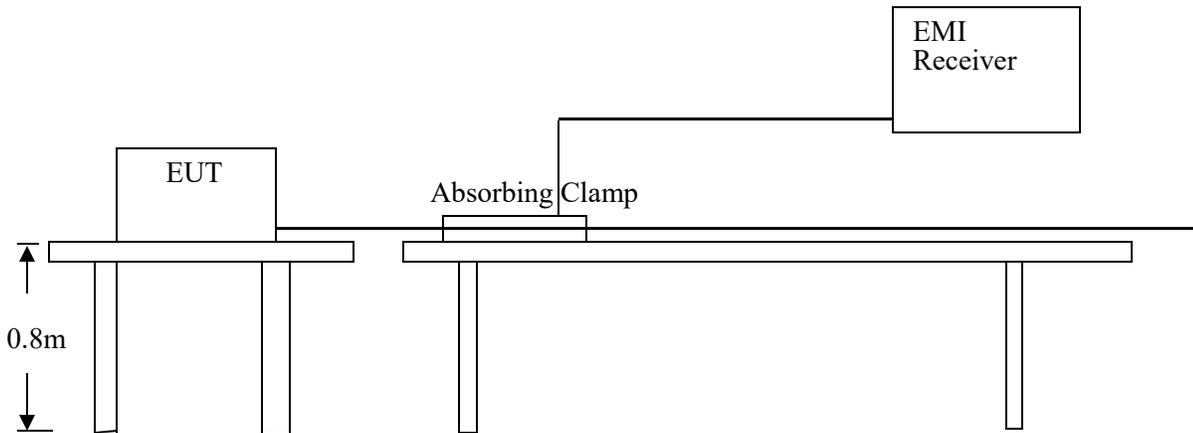

1.3.5 Test Data and Records

Test case does not apply to the test object

1.3.6 Verdict

The EUT met the requirement.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

1.4 Discontinuous Disturbance Voltage at Mains Terminal (Click)

1.4.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Serial No.	Cal. Date	Cal. Due date
1	lick Meter	AFJ	CL55C	5040019044	2024-12-03	2025-12-02

1.4.2 Description of Measurement Conditions

Temperature: 22°C
 Humidity: 56%
 Pressure: 1033mbar
 Electromagnetic environment: normal


1.4.3 Limits of Click

For discontinuous disturbance, the click limit is attained by increasing the relevant limit of Continuous Disturbance Voltage with:

$$44\text{dB} \quad \text{for} \quad N < 0.2 \quad \text{or} \\ 20\lg(30/N) \text{ dB} \quad \text{for} \quad 0.2 \leq N < 30$$

1.4.4 Configuration

The configuration in accordance with the requirement in EN55014-1, the sketch map as follow:

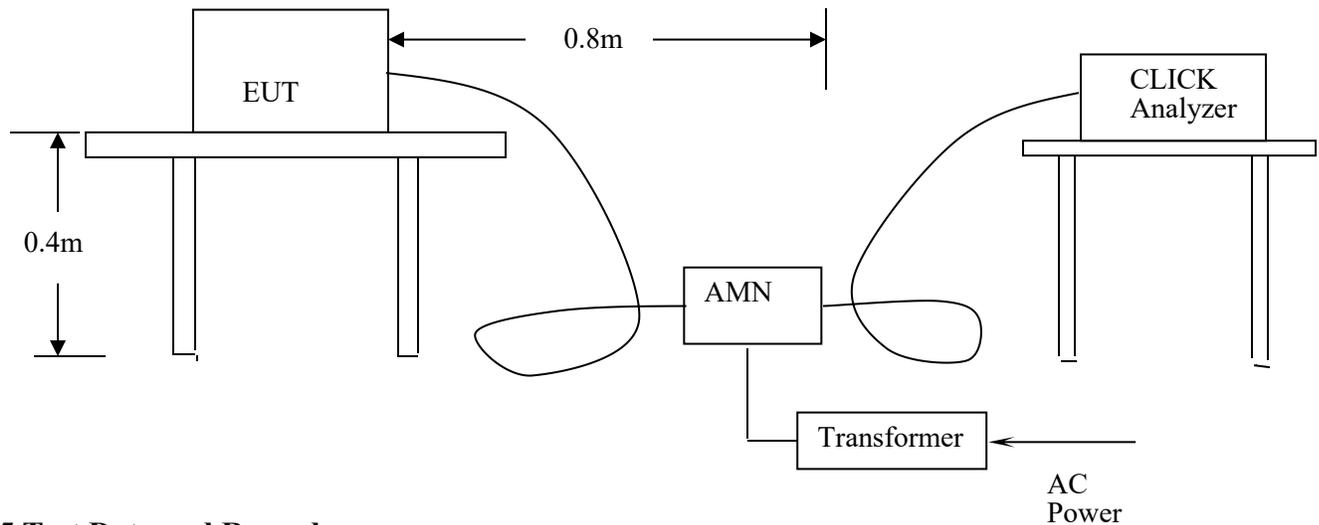

1.4.5 Test Data and Records

Test case does not apply to the test object

1.4.6 Verdict

The EUT met the requirement.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

2 –IEC/EN 61543

Description of Performance Criterion

Performance Criterion A

The apparatus shall continue to operate as intended during the test. No degradation of performance or loss of function is allowed below a performance level (or permissible loss of performance) specified by the manufacturer, when the apparatus is used as intended. If the minimum performance level or the permissible performance loss is not specified by the manufacture, then either of these may be derived from the product description and documentation, and from what the user may reasonably expect from the apparatus if used as intended.

Performance Criterion B

The apparatus shall continue to operate as intended after the test. No degradation of performance or loss of function is allowed below a performance level (or permissible loss of performance) specified by the manufacturer, when the apparatus is used as intended. During the test, degradation of performance is allowed, however, no change of actual operating state or stored data is allowed. If the minimum performance level or the permissible performance loss is not specified by the manufacture, then either of these may be derived from the product description and documentation, and from what the user may reasonably expect from the apparatus if used as intended.

Performance Criterion C

Temporary loss of function is allowed, provided the function is self-recoverable or can be restored by the operation of the controls, or by any operation specified in the instructions for use.

2.1 SURGES


2.1.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Series No.	Cal. Date	Cal. Due date
1	Ultra-compact simulator	EM test	UCS500M4	V050710012 2	2024-10-08	2025-10-07

2.1.2 Description of Measurement Conditions

Temperature: 21 °C
 Humidity: 58%
 Pressure: 1033mbar
 Electromagnetic environment: normal

2.1.3 Configuration

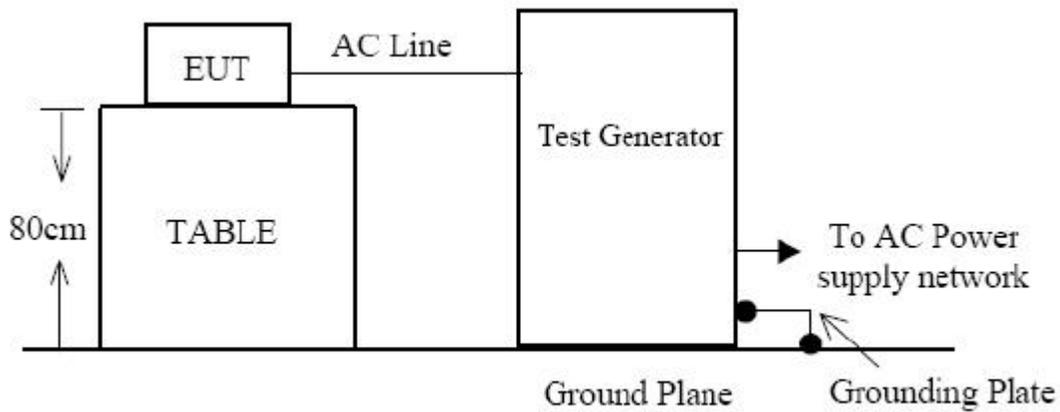

Remark: Test generator includes control center, surge combination and coupler.

2.1.4 Test Data and Records

Level	Voltage	Poll	Phase angle	Path	Pass	Fail
1	5.0kV	±	0°, 90°, 180°, 270°	L-N	B	
2	4.0kV	±	0°, 90°, 180°, 270°	L-N	B	
3	2.0kV	±	0°, 90°, 180°, 270°	L-N	B	

2.1.5 Verdict

The EUT was working as normal, the EUT met the requirement.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

2.2 ESD

2.2.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Series No.	Cal. Date	Cal. Due date
1	Electrostatic Discharge Simulator	KIKUSUI	KES4021	LL004798	2024-12-24	2025-12-23

2.2.2 Description of Measurement Conditions

Temperature: 21 °C
 Humidity: 58%
 Pressure: 1033mbar
 Electromagnetic environment: normal

2.2.3 Configuration

The configuration is in accordance with the requirement in EN 61000-4-2, see the photo in appendix.

2.2.4 Test Data and Records

Air Discharge

EN61000-4-2 Test Points	Test Levels															
	-2 kV	+2 kV	-4 kV	+4 kV	-6 kV	+6 kV	-8 kV	+8 kV	-10 kV	+10 kV	-12.5 kV	+12.5 kV	-15 kV	+15 kV	-20 kV	+20 kV
EUT Front Side	B	B	B	B	B	B	B	B								
EUT Top Side	B	B	B	B	B	B	B	B								
EUT Back Side	B	B	B	B	B	B	B	B								
EUT Left Side	B	B	B	B	B	B	B	B								
EUT Right Side	B	B	B	B	B	B	B	B								

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

Direct Contact

Test Levels																
EN61000-4-2 Test Points	-2 kV	+2 kV	-4 kV	+4 kV	-6 kV	+6 kV	-8 kV	+8 kV	-10 kV	+10 kV	-12.5 kV	+12.5 kV	-15 kV	+15 kV	-20 kV	+20 kV
EUT Front Side	B	B	B	B	B	B										
EUT Top Side	B	B	B	B	B	B										
EUT Back Side	B	B	B	B	B	B										
EUT Left Side	B	B	B	B	B	B										
EUT Right Side	B	B	B	B	B	B										

2.2.5 Verdict

The EUT was working as normal, the EUT met the requirement.

2.3 EFT/B

4.3.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Series No.	Cal. Date	Cal. Due date
1	Ultra-compact simulator	EM test	UCS500M4	V050710012 2	2024-12-24	2025-12-23

2.3.2 Description of Measurement Conditions

Temperature: 21 °C
 Humidity: 58%
 Pressure: 1033mbar
 Electromagnetic environment: normal

2.3.3 Configuration

The configuration is in accordance with the requirement in EN61000-4-4, see the photo in appendix.

2.3.4 Test Data and Records

Test Levels (kV)									
EN61000-4-4 Test Points		+1.0	-1.0	+2.0	-2.0	+3.0	-3.0	+4.0	-4.0
Power Port of EUT	L	B	B	B	B	B	B	B	B
	N	B	B	B	B	B	B	B	B
	L+N	B	B	B	B	B	B	B	B

2.3.5 Verdict

The EUT was working as normal, so they met the requirement of performance criteria B.

2.4 INJECTED CURRENTS


2.4.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Series No.	Cal. Date	Cal.Due date
1	AM/FM signal generator	AEROFLEX	2023A	202306/668	2025-04-21	2026-04-20
2	PAMP Conducted RF test system	HAEFFLY	PAMP250	151730	2025-04-21	2026-04-20
3	CDN impedance and K-factor	LUTHI	L-801 M2/M3	9931	/	/

2.4.2 Description of Measurement Conditions

Temperature: 22°C
 Humidity: 59%
 Pressure: 1033mbar
 Electromagnetic environment: normal

2.4.3 Configuration

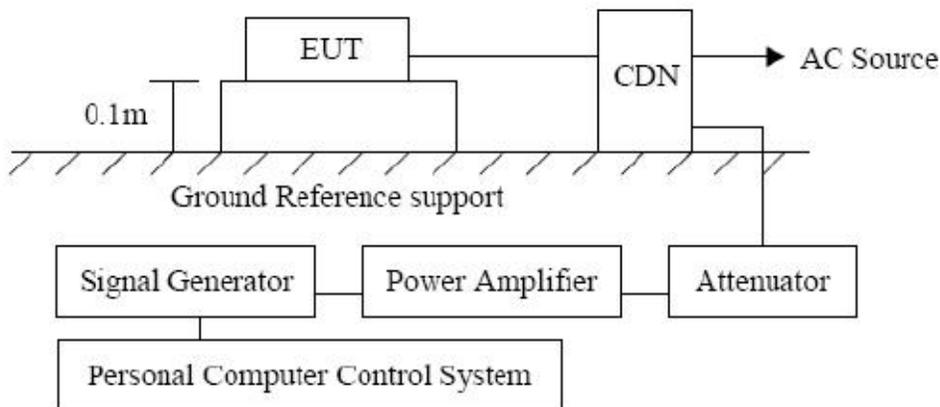

2.4.4 Test Data and Records

EN61000-4-6 Test Points	Frequency range MHz	Levels	Voltage Level (e.m.f.)V	Pass	Fail
Power Line	0.15-80MHz	1	1		
		2	3	A	
		3	10		
		X	Special		

2.4.5 Verdict

The EUT was working as normal, the EUT met the requirement.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

2.5 VOLTAGE DIPS AND INTERRUPTIONS


2.5.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Series No.	Cal. Date	Cal. Due date
1	Ultra-compact simulator	EM test	UCS500M4	V0507100789	2024-10-08	2025-10-07
2	Motorised Variac	EM test	MV2616	V0507100459	2024-10-08	2025-10-07

2.5.2 Description of Measurement Conditions

Temperature: 21 °C
 Humidity: 58%
 Pressure: 1033mbar
 Electromagnetic environment: normal

2.5.3 Configuration

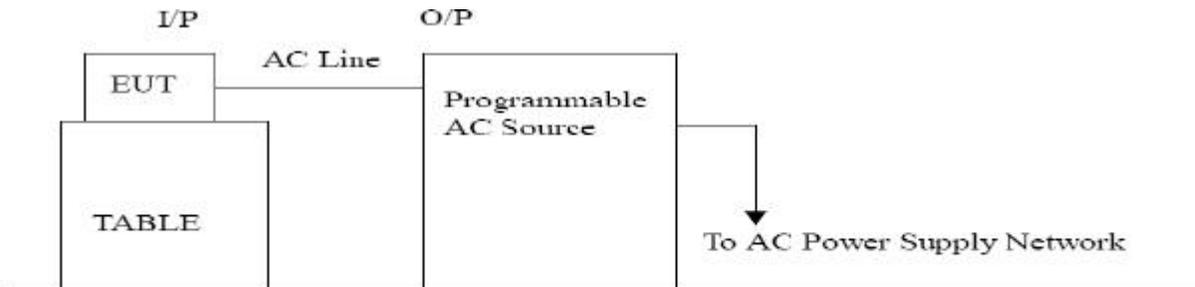

2.5.4 Test Data and Records

Environmental phenomena	Test level in % U_T	Duration (in periods of the rated frequency)	Phase Angle	Pass	Fail
Interruptions	0	0.5T	0/180	C	
Voltage dips in % U_T	60	40	10T	0/180	C
	30	70	50T	0/180	C
	0.85	1.1	50T	0/180	C

2.5.5 Verdict

The EUT was working as normal, the EUT met the requirement.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

2.6 Radio-frequency electromagnetic field


2.6.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Serial No.	Cal. Date	Cal. Due date
1	Ultra broadband antenna	Rohde & Schwarz	HL562	100944	2024-12-08	2025-12-07
2	amplifier	AR	30W1000B	0327284	--	--
3	amplifier	AR	30S1G3	0324978	--	--
4	power meter	Rohde & Schwarz	NRP	101641	2024-08-04	2025-08-03
5	Signal generator	Rohde & Schwarz	SMR40	100657	2024-10-08	2025-10-07

2.6.2 Description of Measurement Conditions

Temperature: 23 °C
 Humidity: 60%
 Pressure: 1033mbar
 Electromagnetic environment: normal

2.6.3 Configuration

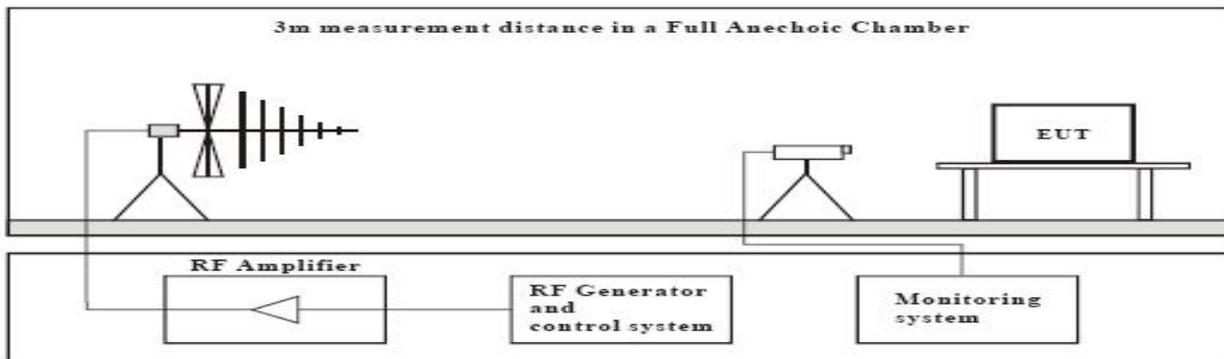

2.6.4 Test Data and Records

Frequency Range (MHz)	Front Side (10 V/m)		Rear Side (10V/m)		Left Side (10V/m)		Right Side (10V/m)	
	VERT	HORI	VERT	HORI	VERT	HORI	VERT	HORI
80-1000	A	A	A	A	A	A	A	A

2.6.5 Verdict

The EUT was working as normal, the EUT met the requirement.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

2.7 Power-frequency magnetic field


2.7.1 Test Equipment List and Details

Item	Test Equipment	Manufacturer	Model No.	Serial No.	Cal. Date	Cal. Due date
1	Magnetic field tester	HAEFELY TEST AG	MGA 100	152676	2024-12-08	2025-12-07
2	Active loop	EMCO	6502	9003-2484	2024-12-08	2025-12-07

2.7.2 Description of Measurement Conditions

Temperature: 22°C
 Humidity: 59%
 Pressure: 1033mbar
 Electromagnetic environment: normal

2.7.3 Configuration

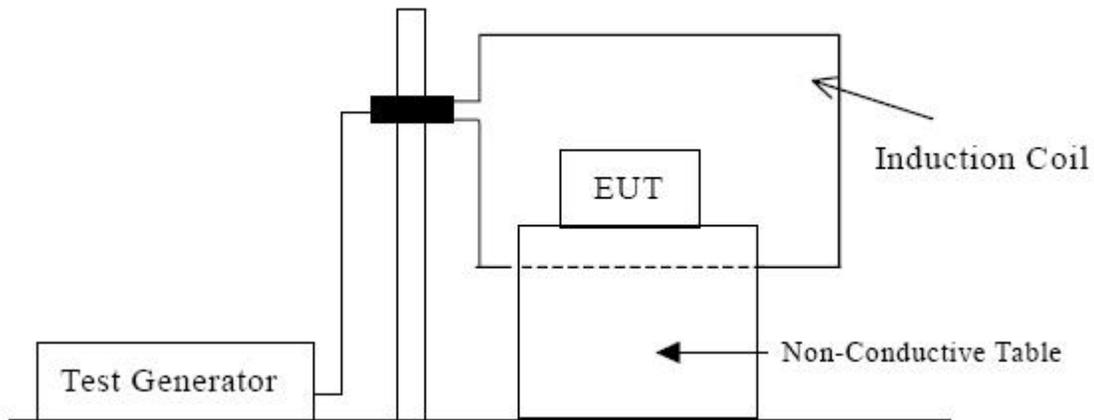

2.7.3 Test Data and Records

Power Frequency Magnetic Field	Testing Duration	Coil Orientation	Pass
50Hz/60 Hz 10A/m	1 Min	X-axis	A
50Hz/60 Hz 10A/m	1 Min	Y-axis	A
50Hz/ 60 Hz 10A/m	1 Min	Z-axis	A

2.7.4 Verdict

The EUT was working as normal, so it met the requirement of performance criteria A.

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.

2.8 Current oscillatory transients(ring wave)

2.8.1 Test Data and Records

Levels	Current Level (A)	Pass	Fail
	200A	A	

2.8.2 Verdict

The EUT was working as normal, the EUT met the requirement.

2.9 Conducted common mode disturbances in the frequency range lower than 150 kHz

2.9.1 Test Data and Records

EN61000-4-16 Test Points	Frequency range MHz	Levels	Crement Level	Pass	Fail
Power Line	0.001-0.15MHz	1	1		
		2	20 mA	A	
		3	66 mA	A	

2.9.2 Verdict

The EUT was working as normal, the EUT met the requirement.

Photo documentation:

Type of equipment:	Residual Current Circuit Breaker with Overcurrent Protection
--------------------	--

Details of:	
View:	
<input checked="" type="checkbox"/> general	
<input type="checkbox"/> front	
<input type="checkbox"/> rear	
<input type="checkbox"/> right	
<input type="checkbox"/> left	
<input type="checkbox"/> top	
<input type="checkbox"/> bottom	

Details of:	
View:	
<input checked="" type="checkbox"/> general	
<input type="checkbox"/> front	
<input type="checkbox"/> rear	
<input type="checkbox"/> right	
<input type="checkbox"/> left	
<input type="checkbox"/> top	
<input type="checkbox"/> bottom	

--- End of TCF ---

Note: This report shall not be reproduced except in full, without the written approval of **Shanghai Global Testing Services Co., Ltd.** This document may be altered or revised by **Shanghai Global Testing Services Co., Ltd.** personnel only, and shall be noted in the revision section of the document.